



Transite Pipe Replacements
Contract No. C-2196, CIP 690236-100112

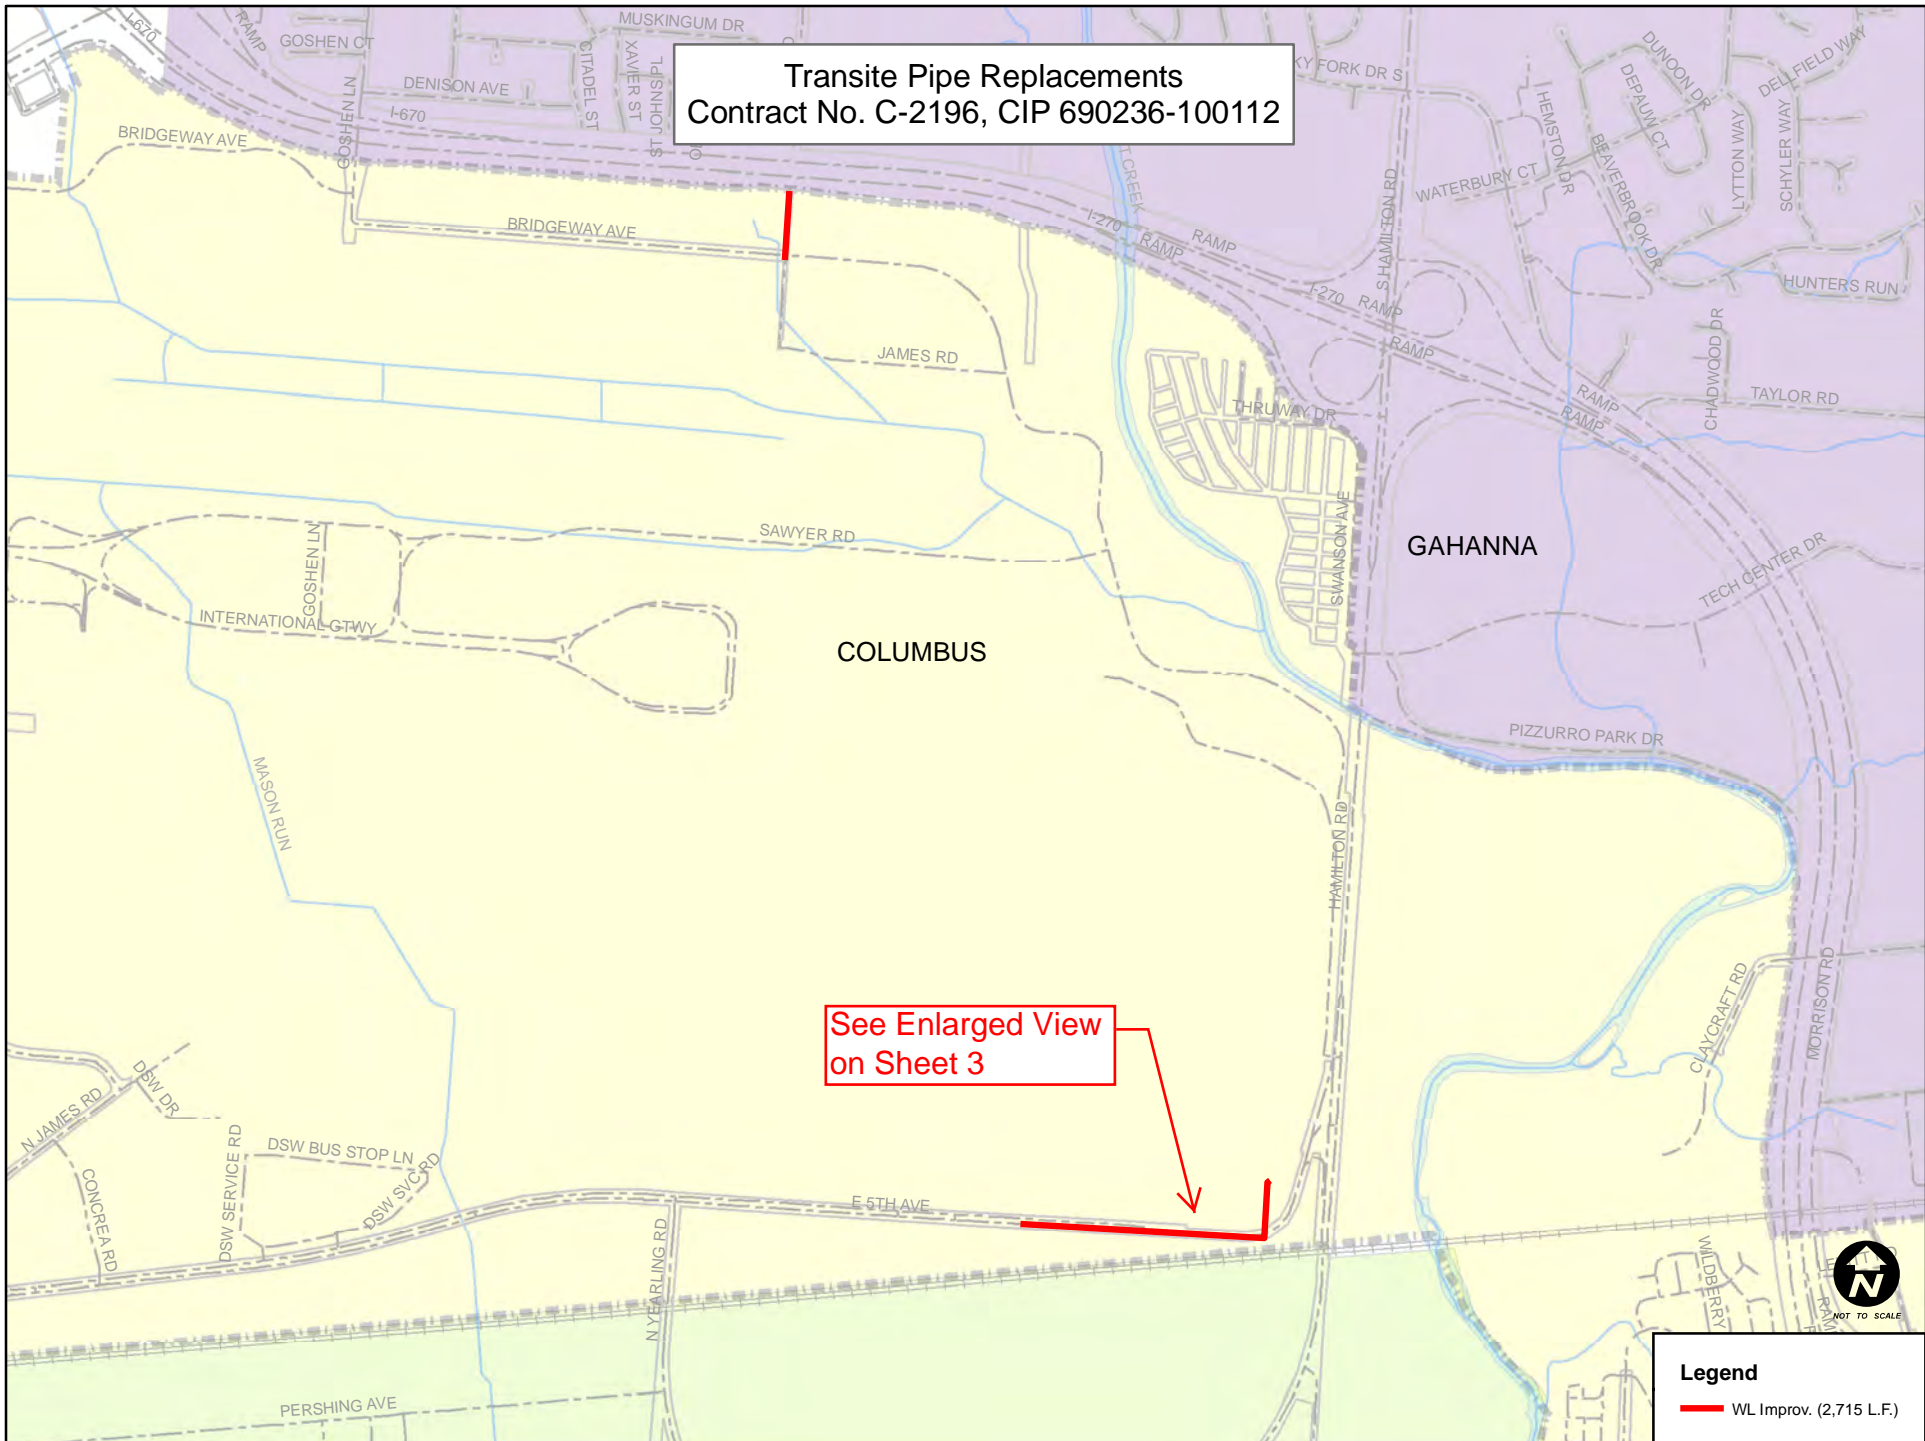


See Enlarged View
on Sheet 3

Legend

- WL Improv. (2,715 L.F.)




Transite Pipe Replacements
 Contract No. C-2196, CIP 690236-100112

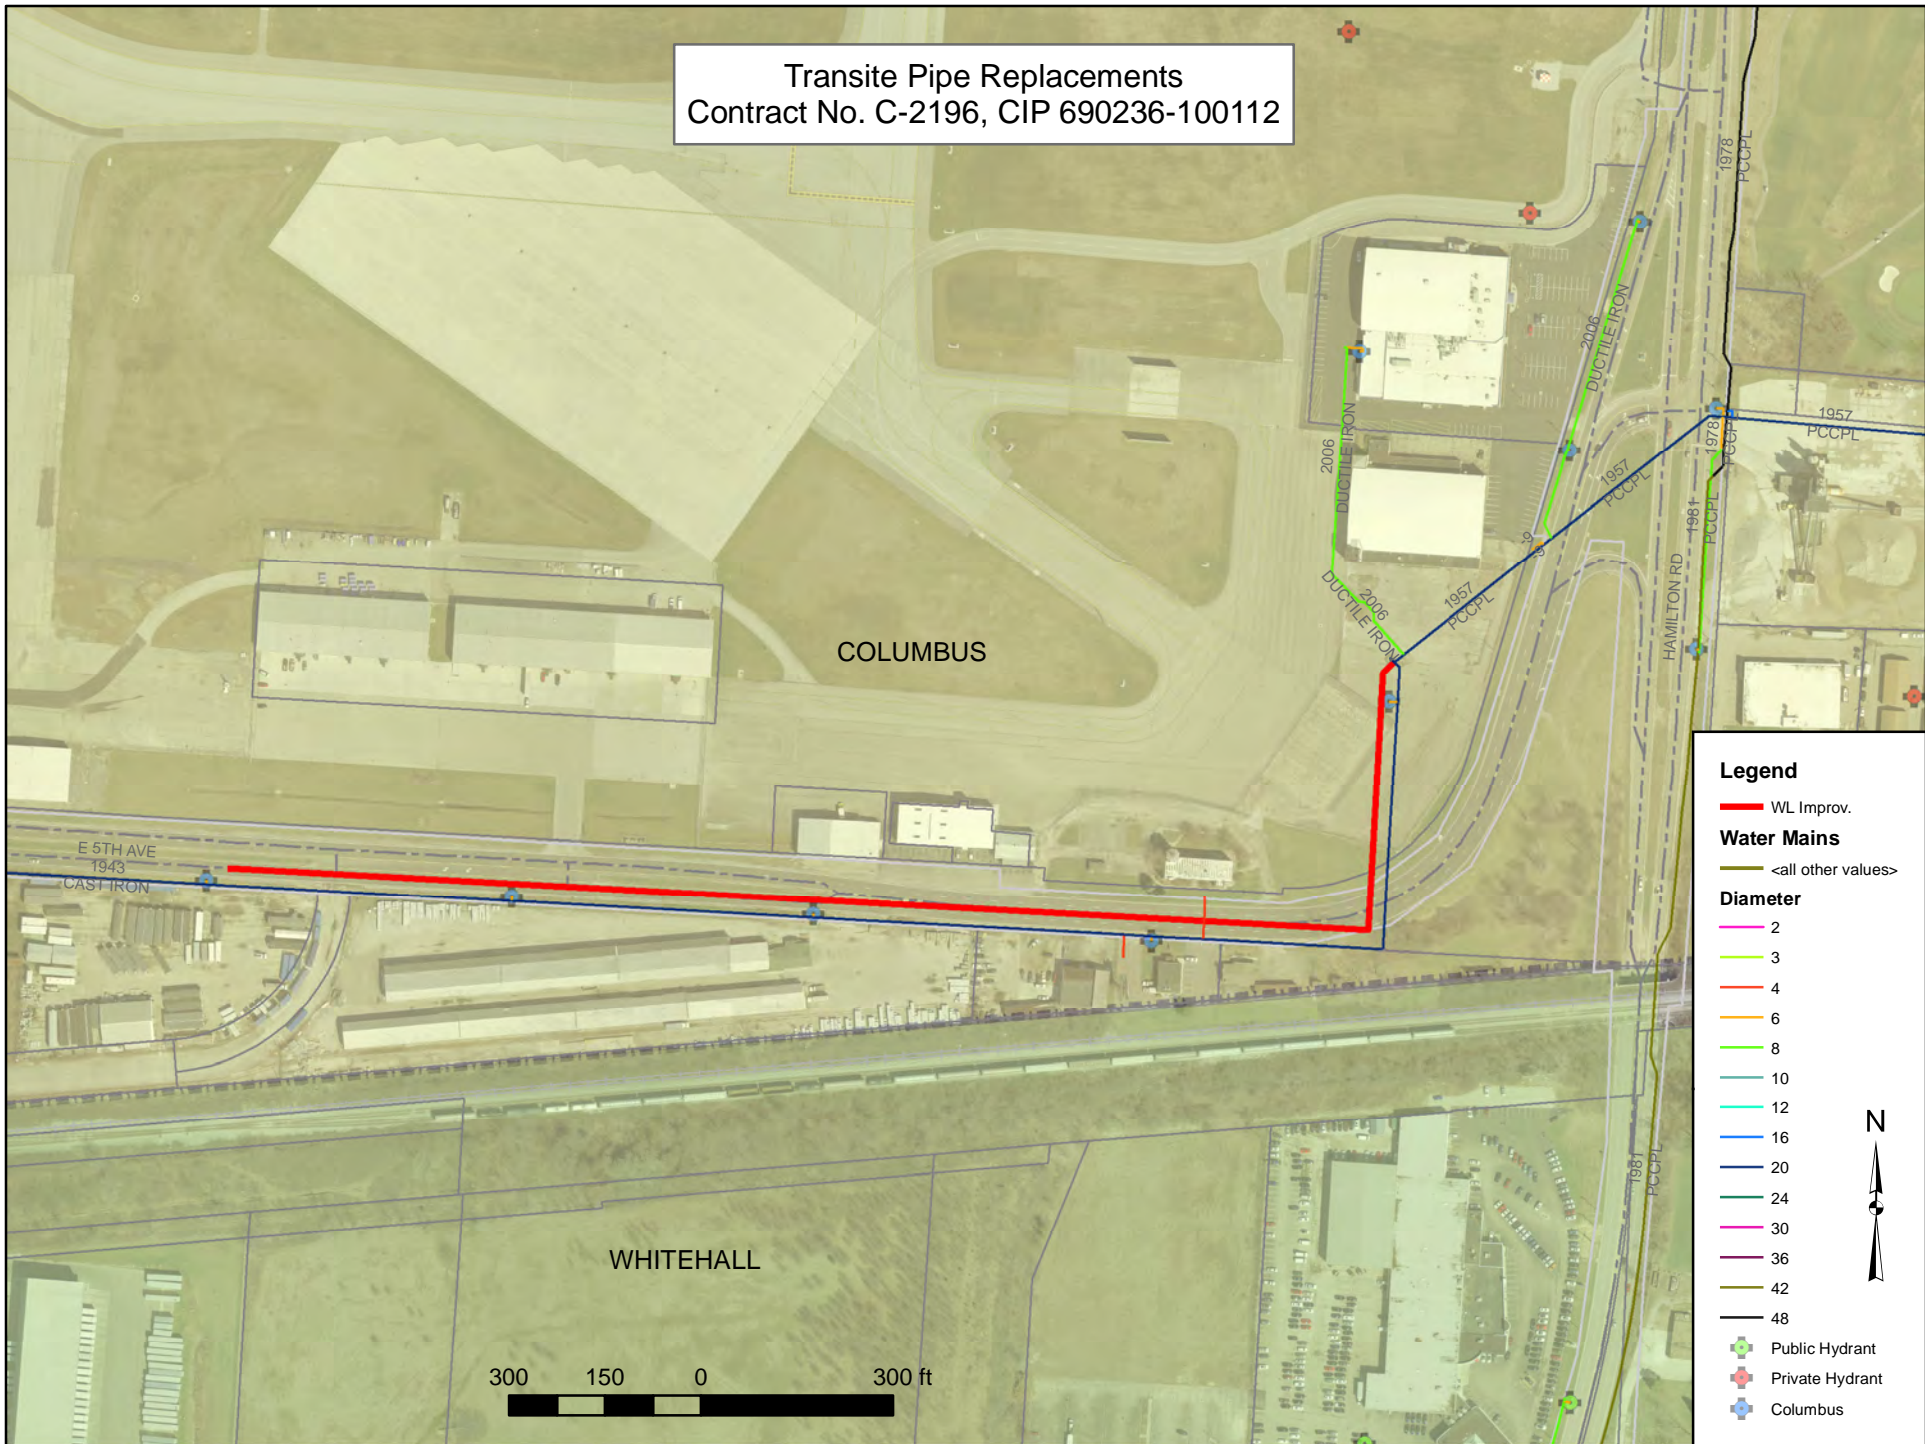

Legend

- WL Improv.
- Water Mains**
- <all other values>
- Diameter**
- 2
- 3
- 4
- 6
- 8
- 10
- 12
- 16
- 20
- 24
- 30
- 36
- 42
- 48
- + Public Hydrant
- + Private Hydrant
- + Columbus

Transite Pipe Replacements
Contract No. C-2196, CIP 690236-100112

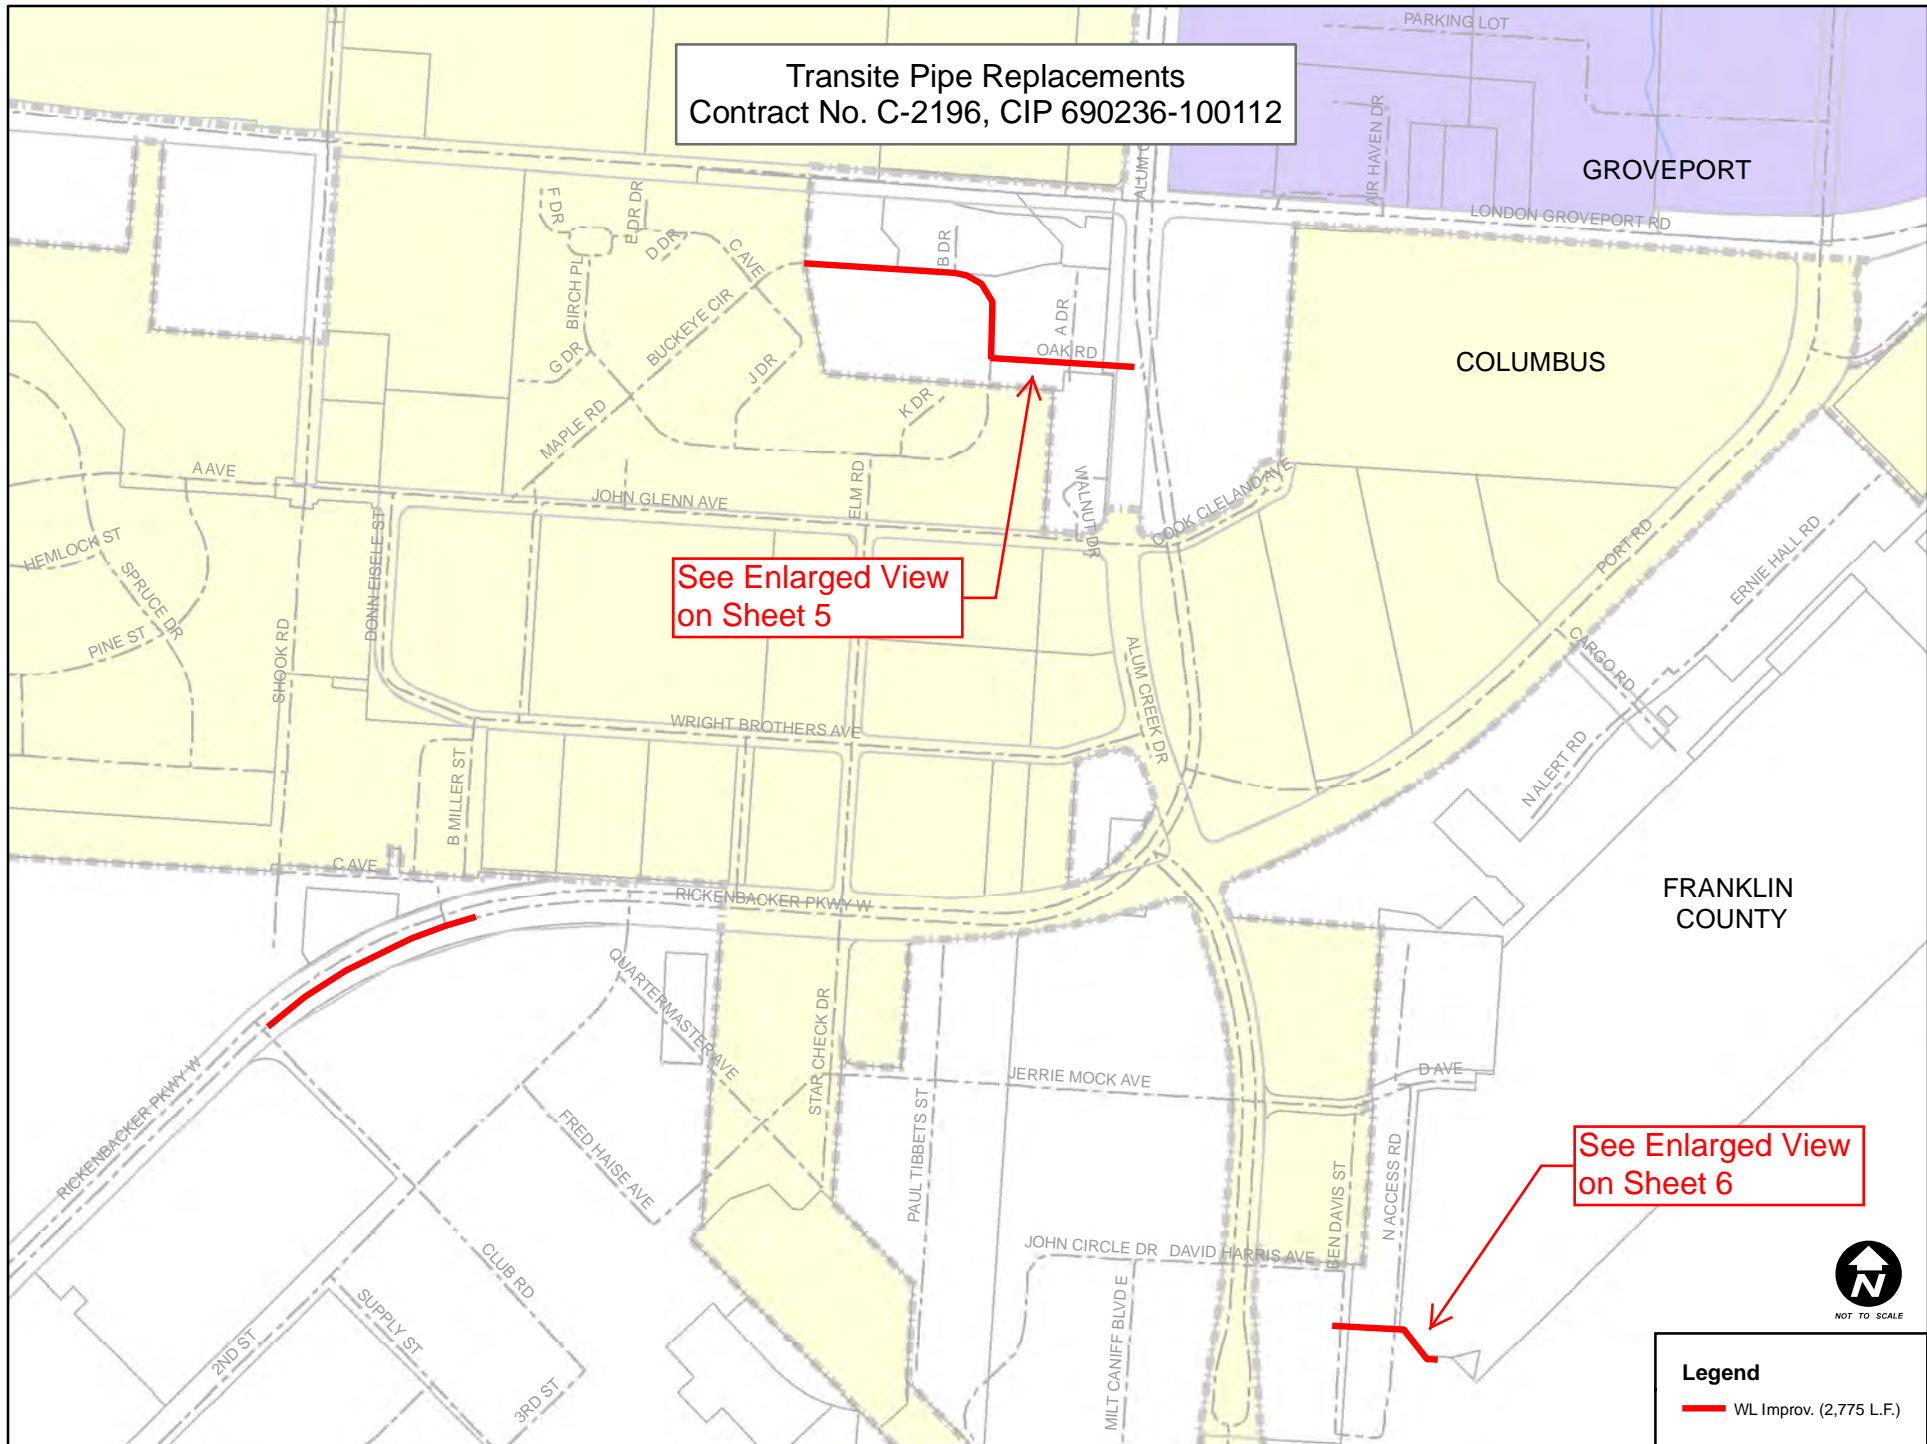

See Enlarged View
on Sheet 5

See Enlarged View
on Sheet 6




NOT TO SCALE

Legend

— WL Improv. (2,775 L.F.)


Transite Pipe Replacements
 Contract No. C-2196, CIP 690236-100112

All Water Service Lines to be Reconfigured and Replaced.

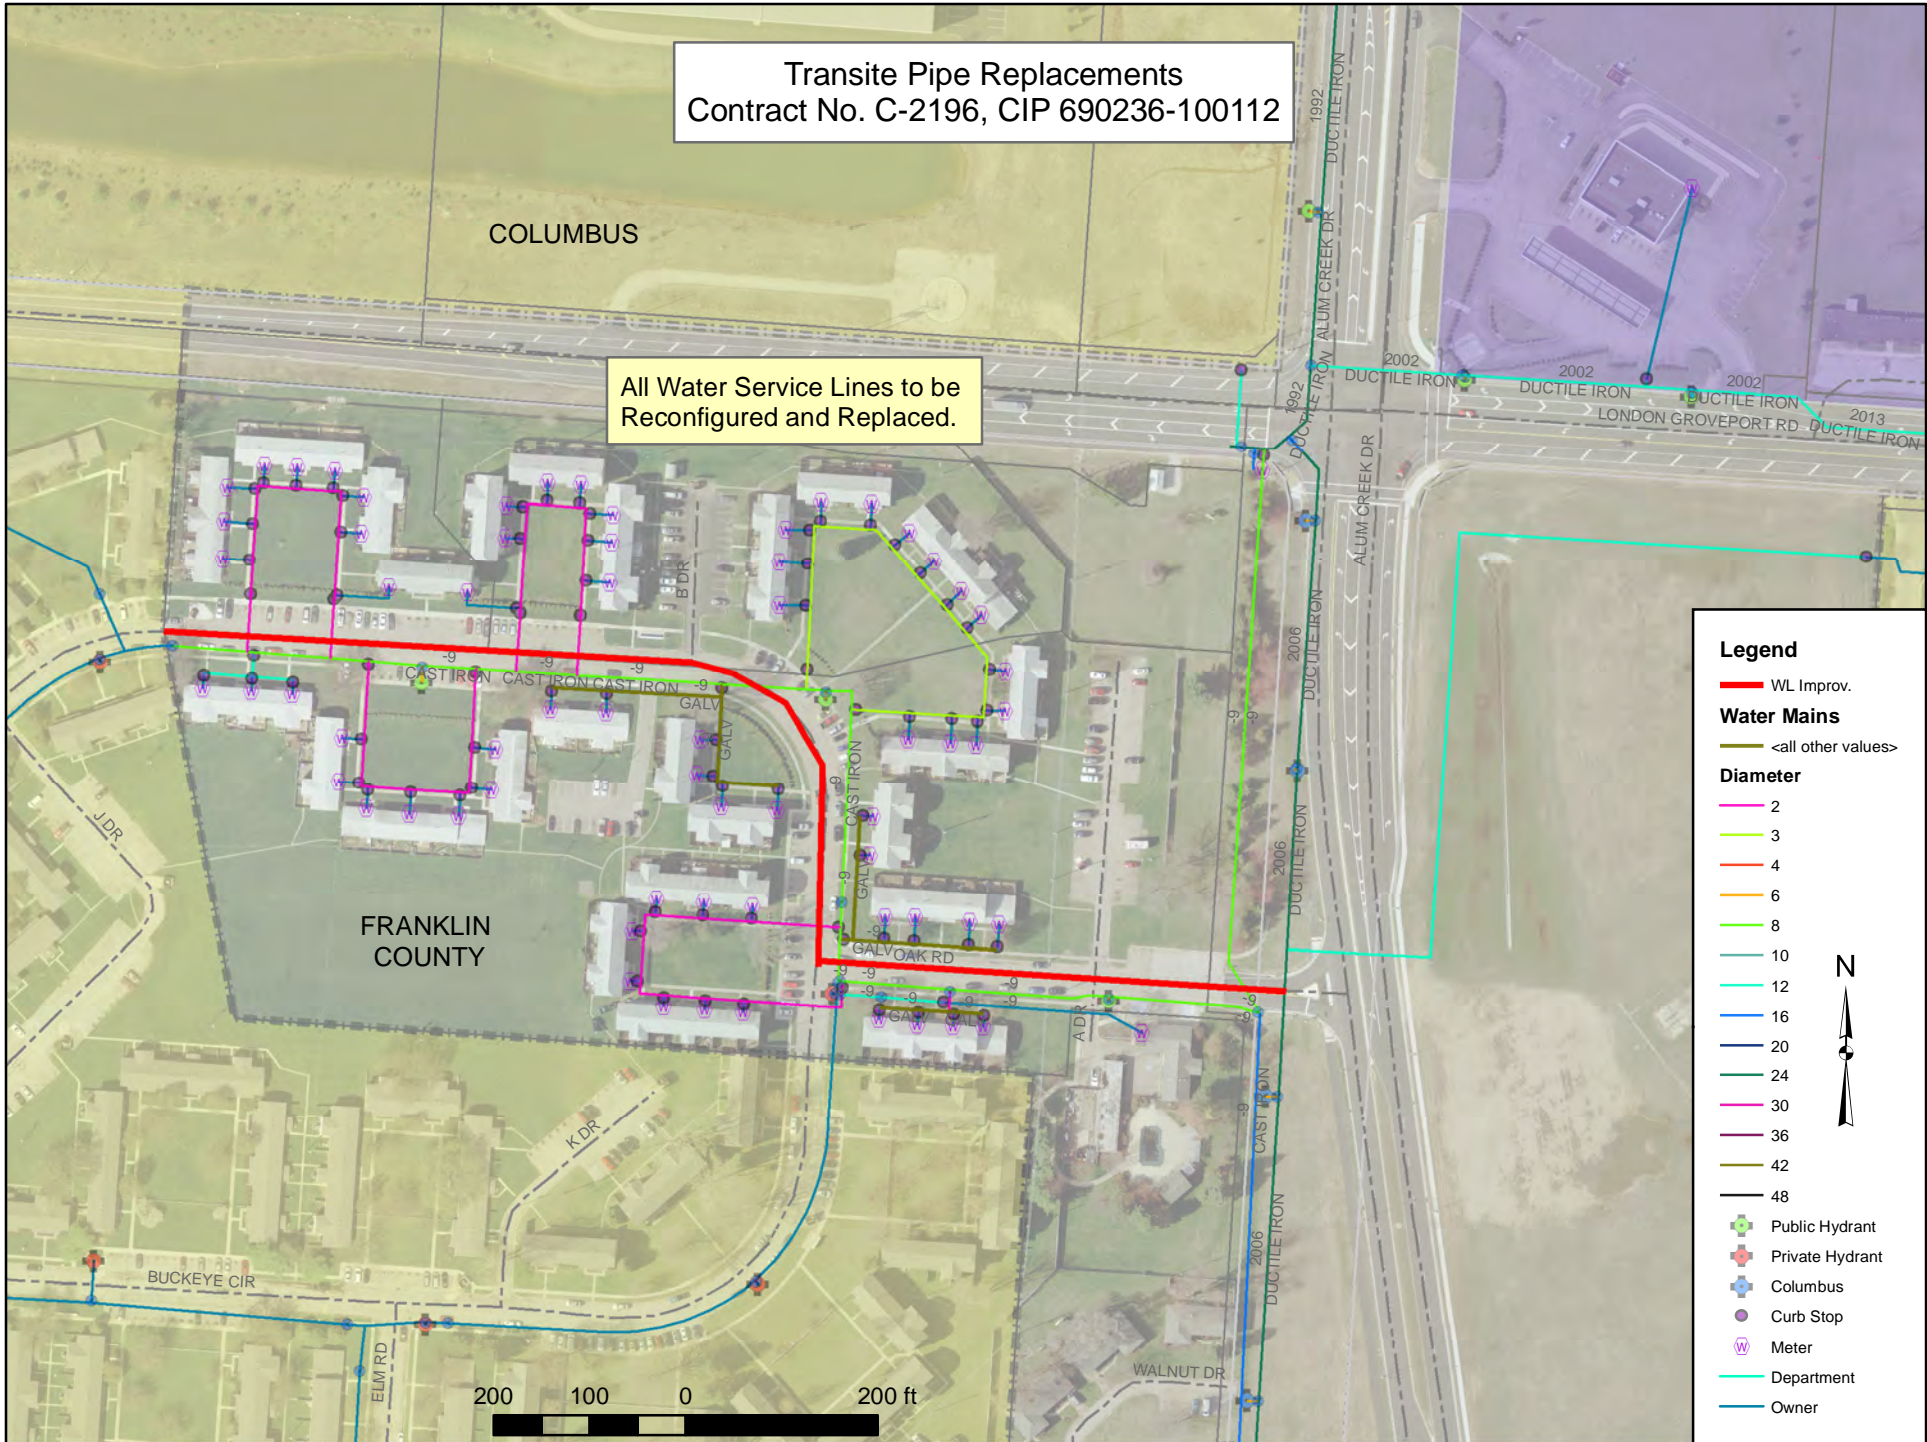


Legend

- WL Improv.
- Water Mains**
- <all other values>
- Diameter**
- 2
- 3
- 4
- 6
- 8
- 10
- 12
- 16
- 20
- 24
- 30
- 36
- 42
- 48
- + Public Hydrant
- + Private Hydrant
- + Columbus
- Curb Stop
- W Meter
- Department
- Owner



Transite Pipe Replacements
Contract No. C-2196, CIP 690236-100112

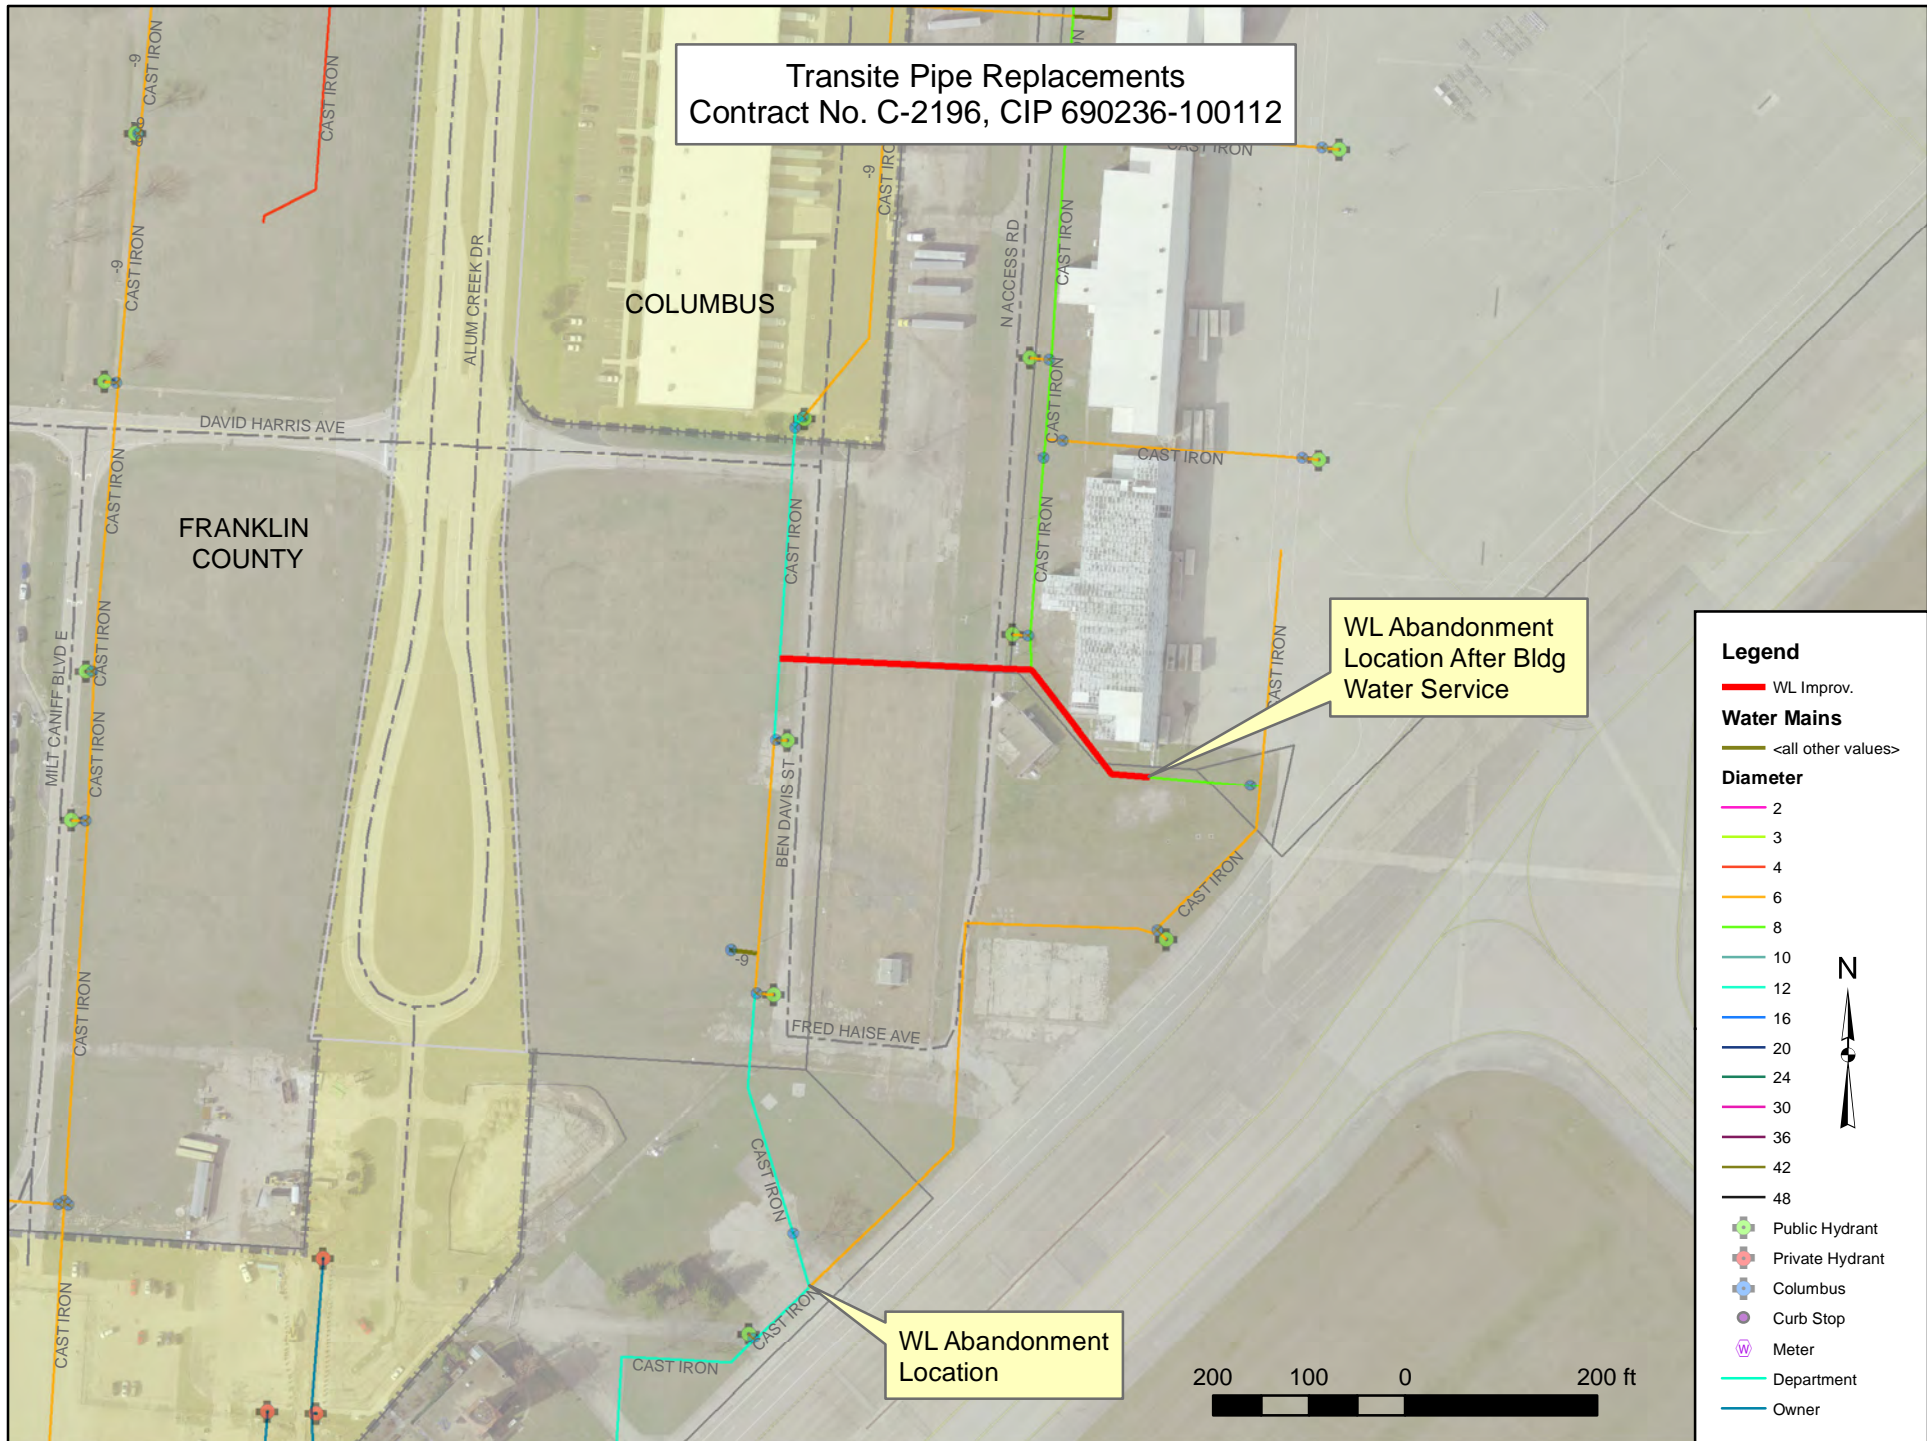




**WL Abandonment
 Location After Bldg
 Water Service**

**WL Abandonment
 Location**

Legend

- WL Improv.
- Water Mains**
- <all other values>
- Diameter**
- 2
- 3
- 4
- 6
- 8
- 10
- 12
- 16
- 20
- 24
- 30
- 36
- 42
- 48
- Public Hydrant
- Private Hydrant
- Columbus
- Curb Stop
- Meter
- Department
- Owner



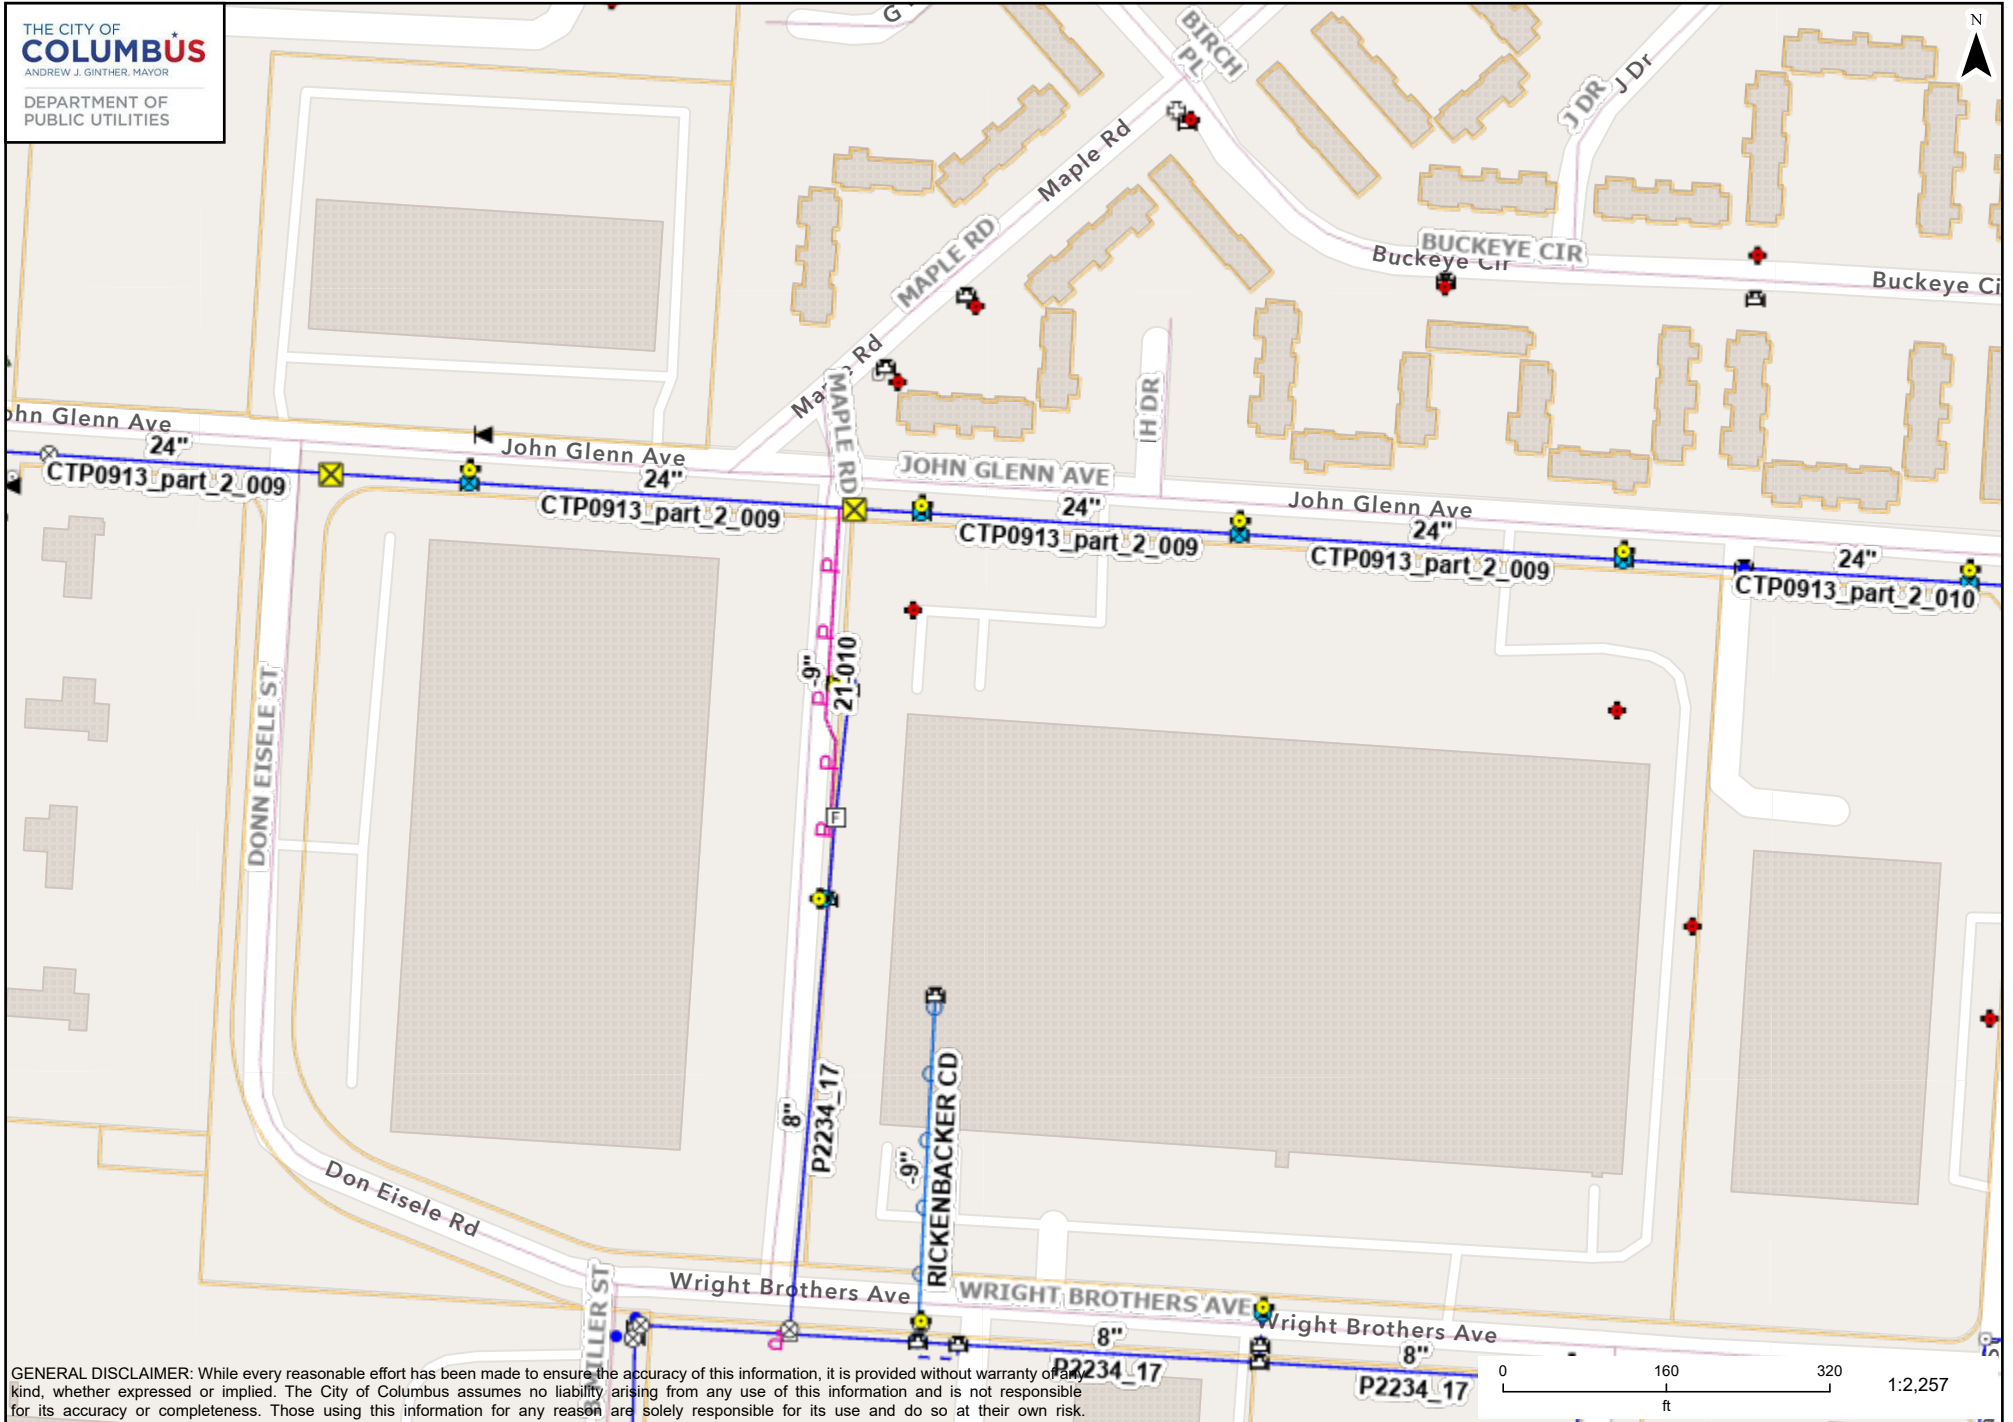

GENERAL DISCLAIMER: While every reasonable effort has been made to ensure the accuracy of this information, it is provided without warranty of any kind, whether expressed or implied. The City of Columbus assumes no liability arising from any use of this information and is not responsible for its accuracy or completeness. Those using this information for any reason are solely responsible for its use and do so at their own risk.